


Data Sheet

Integrated Presetting Valves for Normal Flows RA-N and for Small Flows RA-U

Application

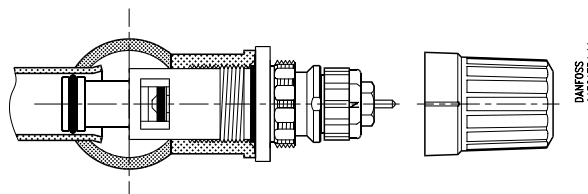

Integrated valves with built-in presetting are designed for incorporation into valve radiators.

The different factory setting values can be recognised by the colour of the presetting rings: red, yellow, white, black, green and blue. See code nos. and technical data.

Integrated valves can be used in single and two pipe installations with circulating pump.

The gland seal of the valve can be replaced while the system is in operation.

To avoid calcification and corrosion, it is important for the composition of the circulating water to comply with the VDI 2035 guidelines.

Danfoss thermostatic sensors types RA 2000 and RAW with patented snap sockets as well as Danfoss thermo-hydraulic actuators can be installed directly onto the integrated valve.

Approved to EN 215



Integrated presetting valves are manufactured to the highest standards, and RA-N 013G0360 and RA-U 013G0361 are approved to the European standard EN 215.

Code Nos. and Technical Data

| Type | Code number | Setting | Colour of presetting ring |
|------|-------------|---------|---------------------------|
| RA-N | 013G0360 | N | Red |
| RA-U | 013G0361 | N | Yellow |
| RA-N | 013G0363 | 1.1 | White |
| RA-N | 013G0364 | 3.9 | Black |
| RA-N | 013G0365 | 5.2 | Green |
| RA-N | 013G0366 | 6.5 | Blue |
| RA-N | 013G0367 | N, 2 | Red |

| Type | Connection thread | Max. water temp. °C | Differential pressure ¹⁾ | | Test press. bar | Work. press. bar |
|------|-------------------|------------------------|-------------------------------------|-------------|--------------------|---------------------|
| | | | Rec. bar | Tech bar | | |
| RA-N | G ½ A | 120 | 0.05-0.2 | 0.6 | 16 | 10 |
| RA-U | G ½ A | | | | | |

| Type | Presetting | | | | | | | | |
|------|-------------------------------|------|------|------|------|------|------|------|----------|
| | k_v -value ^{2) 3)} | | | | | | | | k_{vs} |
| | 1 | 2 | 3 | 4 | 5 | 6 | 7 | N | N |
| RA-N | 0.14 | 0.21 | 0.26 | 0.32 | 0.46 | 0.59 | 0.73 | 0.87 | 1.05 |
| RA-U | 0.04 | 0.05 | 0.07 | 0.09 | 0.13 | 0.18 | 0.24 | 0.34 | 0.55 |

¹⁾ The technical differential pressure indicates the upper limit for a proper valve function. In most two-pipe systems the recommended differential pressure is sufficient. In order to achieve a noiseless function we recommend in smaller systems to apply automatic bypass valves or automatic balancing valves. If pump differential pressure exceeds the recommended max. valve differential pressure it is recommended that an automatic balancing valve type ASV-P/PV is added to the system.

²⁾ The k_v -values indicate the flow volume (Q) in m³/h at a pressure loss (Δp) across the valve of 1 bar;

$k_v = \frac{Q}{\sqrt{\Delta p}}$. At setting N, the k_v -value in accordance with EN 215 can be stated as $X_p = 2 K$. At lower preset values, X_p will be reduced until approximately $X_p 0.5$ at presetting 1. The table shows the average measured values for integrated valves with radiator. The k_{vs} -values indicate the valve capacity, when the valve is fully open.


³⁾ When using a liquid filled radiator thermostat e.g. RAW, RAS-D or remote setting element type RA 5060 X_p will be increased by factor 1.6 (at setting "N", ref. EN 215).

Spare Parts and Accessories

| Product | Code no. |
|---|-----------------|
| Gland seal, 10 pcs. ¹⁾ | 013G0290 |
| Red protection cap for RA-N valve 013G0360 | 013G0951 |
| Yellow protection cap for RA-U valve 013G0361 | 013G0952 |
| Small O-ring | 633B1427 |
| Big O-ring | 633B0387 |

¹⁾ The gland seal of the valve can be replaced under pressure, i.e. while the installation is in operation.



Design and Dimensions

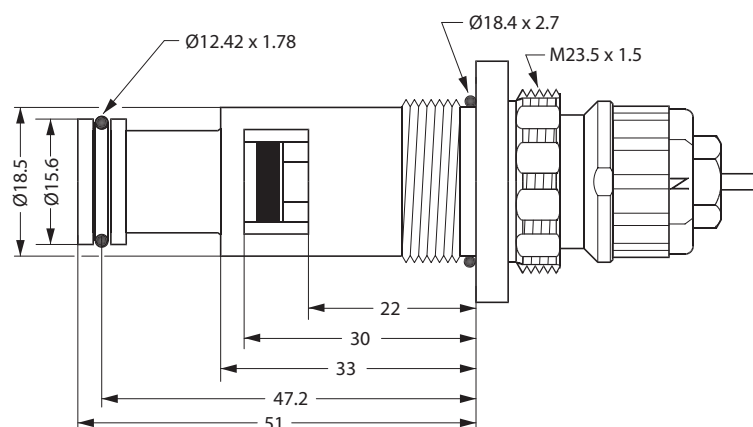

Materials

| Part | RA-N | RA-U |
|-------------------------------|--------------|--------------|
| Valve housing | Ms 58 | Ms 58 |
| Valve seat | Ms 58 | Ms 58 |
| Throttle nozzle | PPS | PPS |
| Setting dial | Plastic | Plastic |
| O-rings | NBR / EPDM | NBR / EPDM |
| Valve spindle | PPS | Ms 58 |
| Valve cone | NBR | NBR |
| Pressure pin and valve spring | Chrome steel | Chrome steel |

Presetting

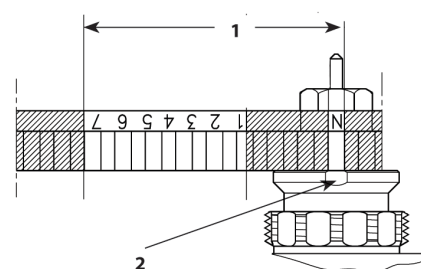

1. Presetting range
2. Reference mark

The presetting values of the integrated valves can be adjusted easily and accurately without the use of tools:

- Remove the protective cap or the thermostatic sensor
- Find the reference mark
- Turn the setting ring until the desired presetting aligns with the reference mark

The presetting is controlled directly without the use of equipment. After installation in the radiator, the reference mark of the valves will not always be positioned in the same place.

Presetting can be selected infinitely variably within the range of 1 to 7. At setting 'N' the valve is fully open. Setting in the shaded areas of the drawing should be avoided.

In a one-pipe installation, the setting 'N' must be used.


Setting 'N' can be used as a flushing position if the system has to be flushed out because of dirt problems.

When the radiator thermostat has been installed, the presetting is protected against unintended regulation.


For Danfoss elements RA 2000 and RAW, a theft protection device is available; this also provides added security against unwanted adjustment of the preset values.

Capacities without Radiator and Fittings

RA-N 013G0360, 013G0363, 013G0364, 013G0365, 013G0366, 013G0367

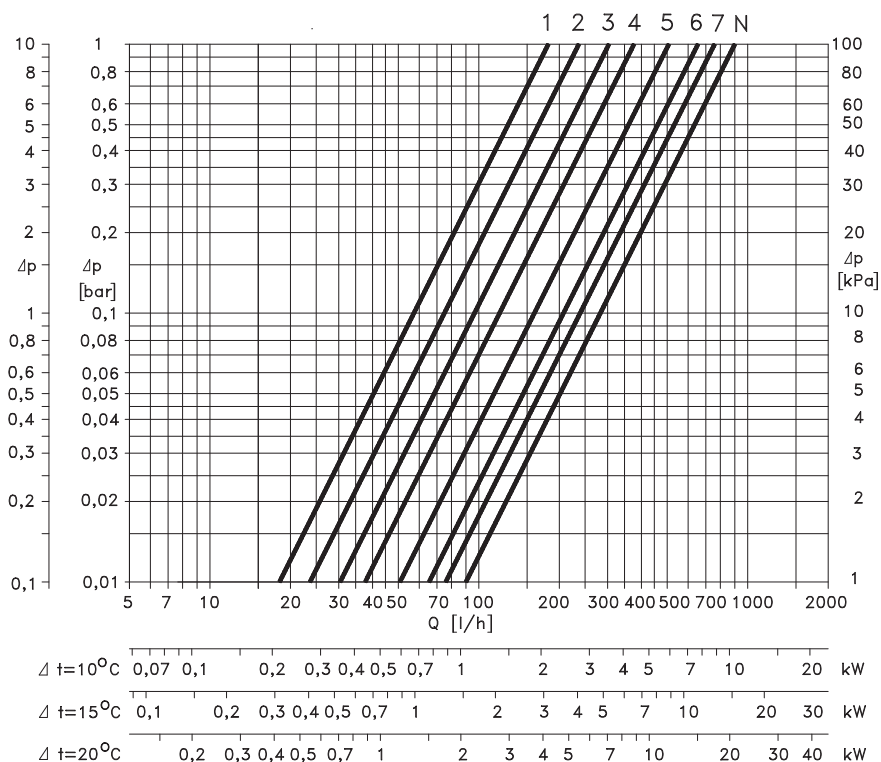


RA-U 013G0361

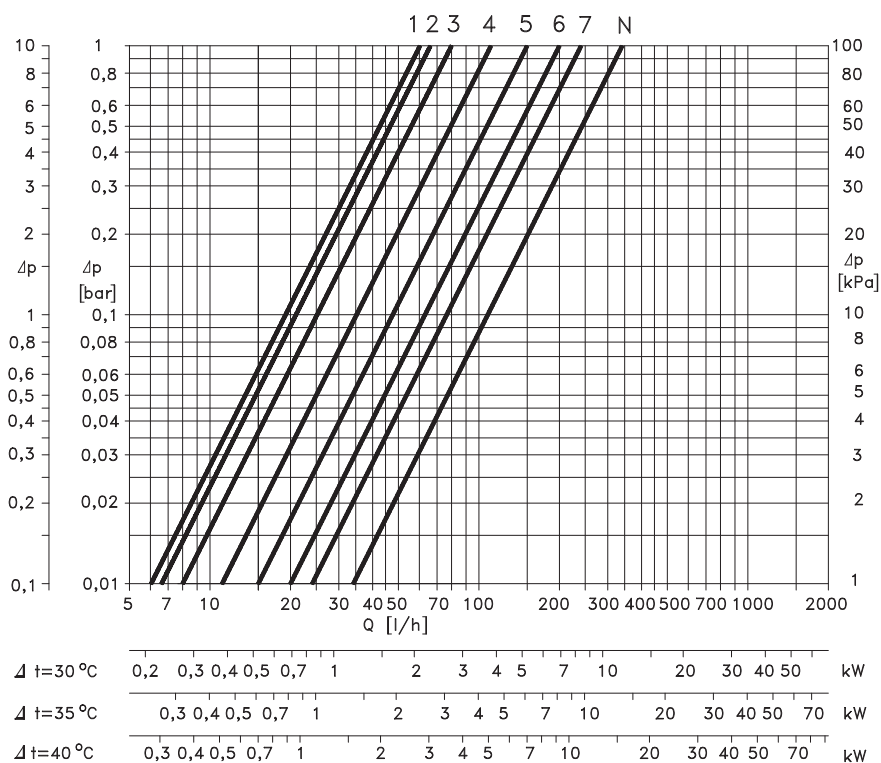

Capacities at $X_p = 2K$ with Danfoss radiator thermostat RA 2000 are measured without radiator and connection fittings.

Dimensions


Standard fittings

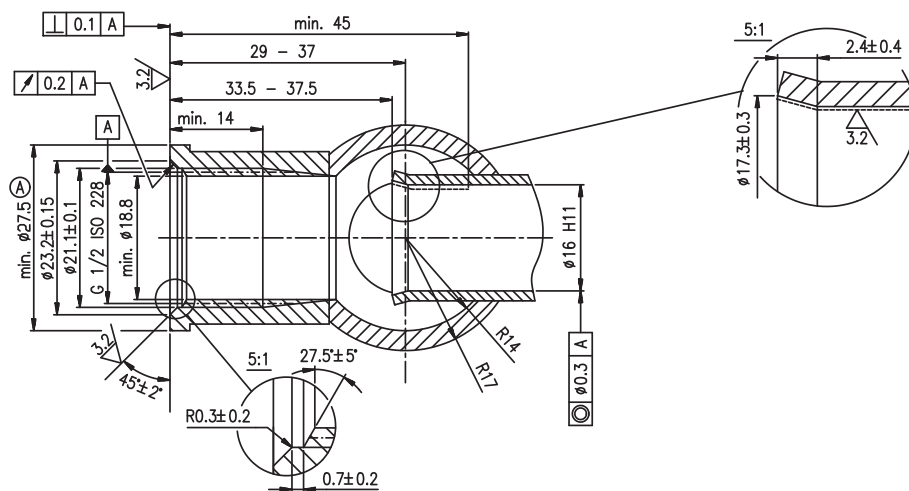

The dimensions stated may vary according to different radiator manufacturers. (013M5058 E0002 001 047 97.03.25)


Mounting Instructions

Installation of an integrated valve into the radiator

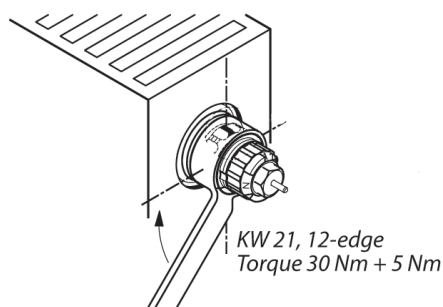

Replacing the Gland Seal

While the system is in operation, the gland seal can be replaced by means of a spanner, KW 10. Hold the setting ring using a 12-edge ring-spanner, KW 17.

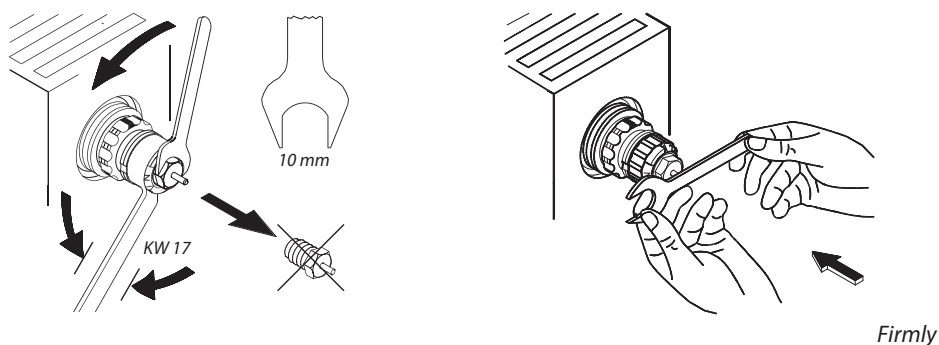

Danfoss A/S
Heating Solutions
Haarupvaenget 11
8600 Silkeborg
Denmark
Phone: +45 7488 8000
Fax: +45 7488 8100
Email: heating.solutions@danfoss.com
www.heating.danfoss.com

Danfoss can accept no responsibility for possible errors in catalogues, brochures and other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary in specifications already agreed. All trademarks in this material are property of the respective companies. Danfoss and the Danfoss logotype are trademarks of Danfoss A/S. All rights reserved.
